

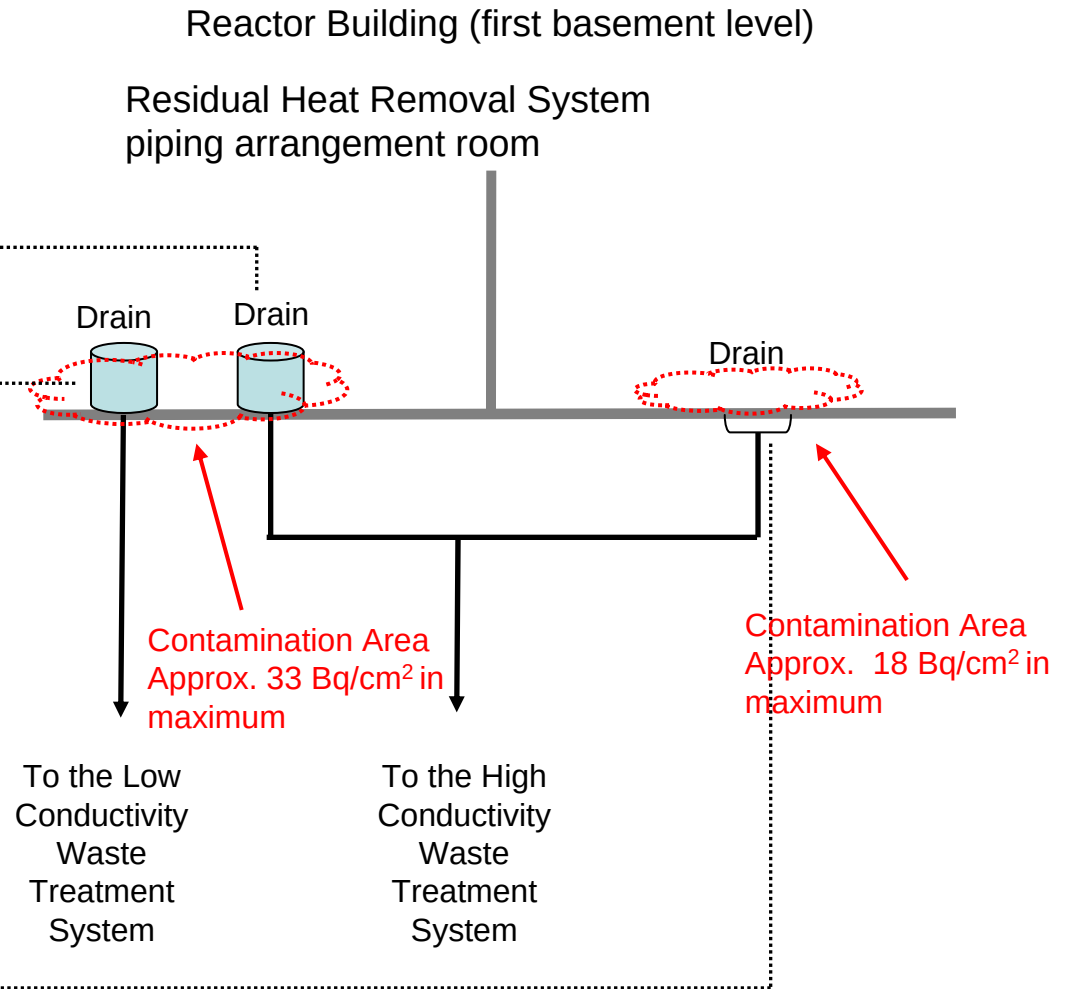


Image of contamination by radioactive materials in the residual heat removal system piping arrangement room in the reactor building of Unit 1 (Controlled Area)