


Dose Rate in the Fukushima Dai—ichi NPS


(Measured by monitoring car)

$\mu\text{Sv/h}$

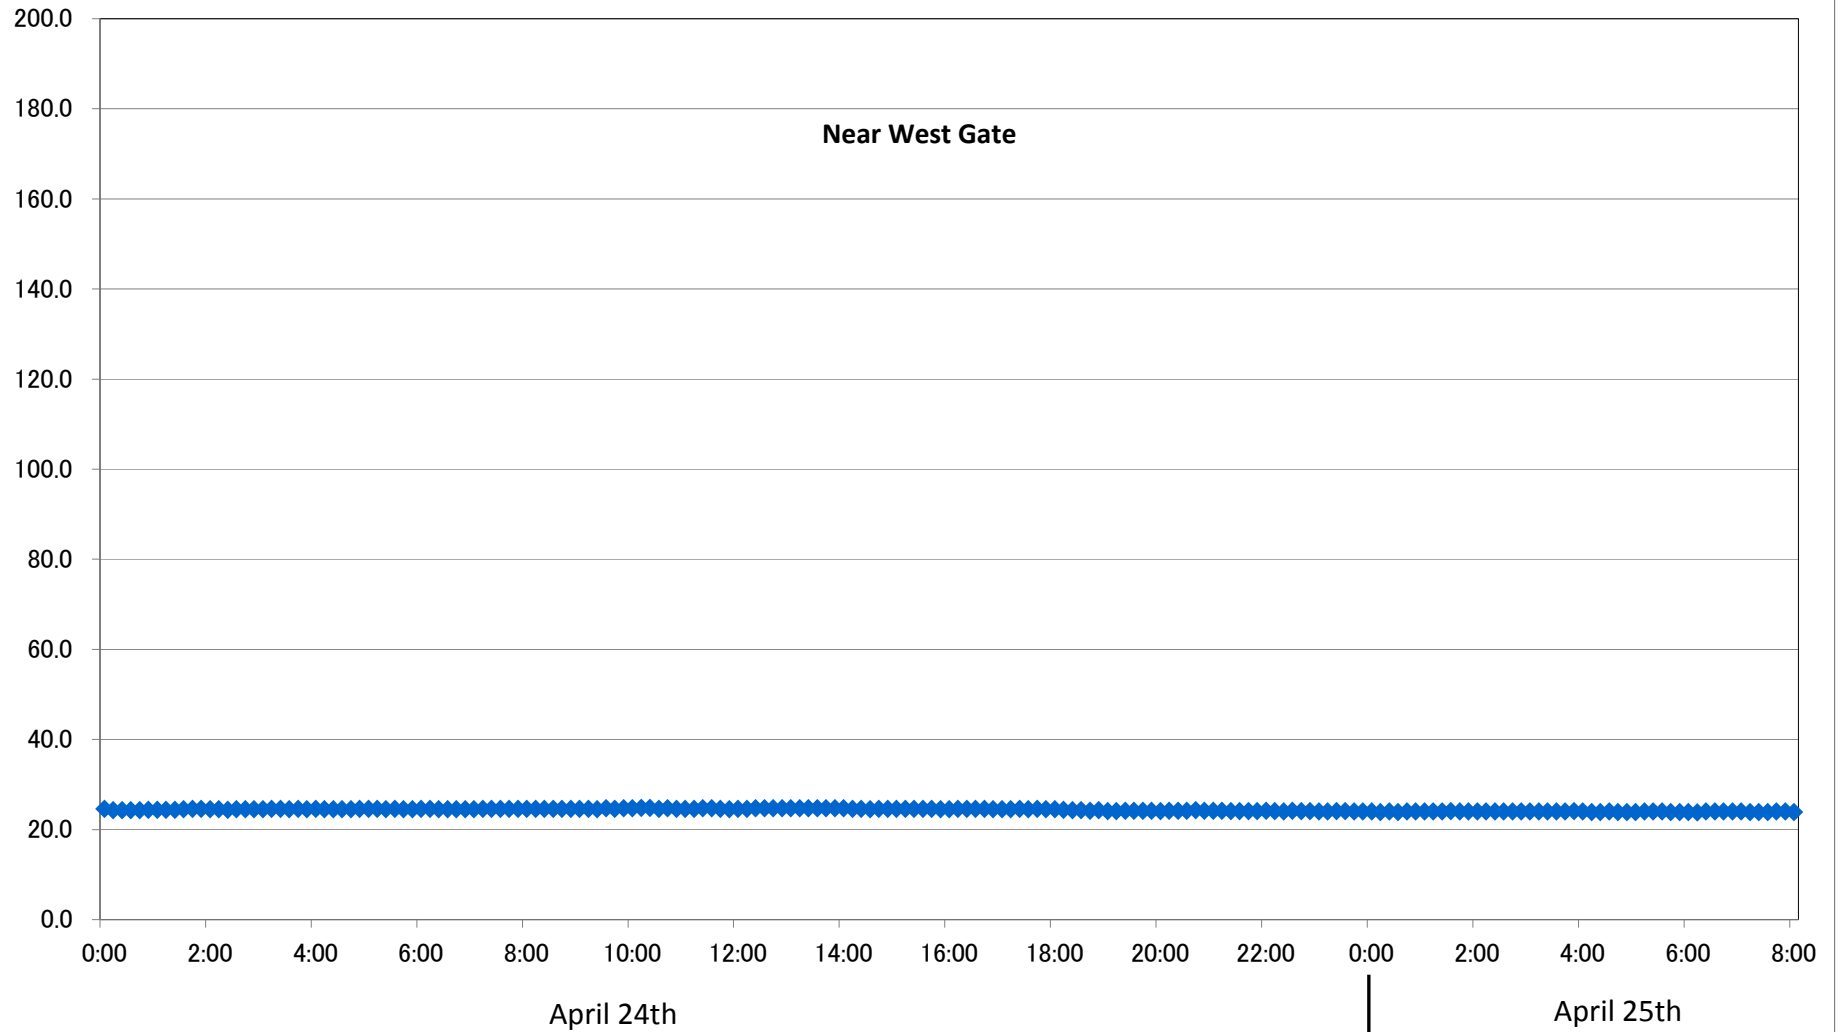


Fukushima Dai-ichi NPS

as of 10:00, April 25th, 2011

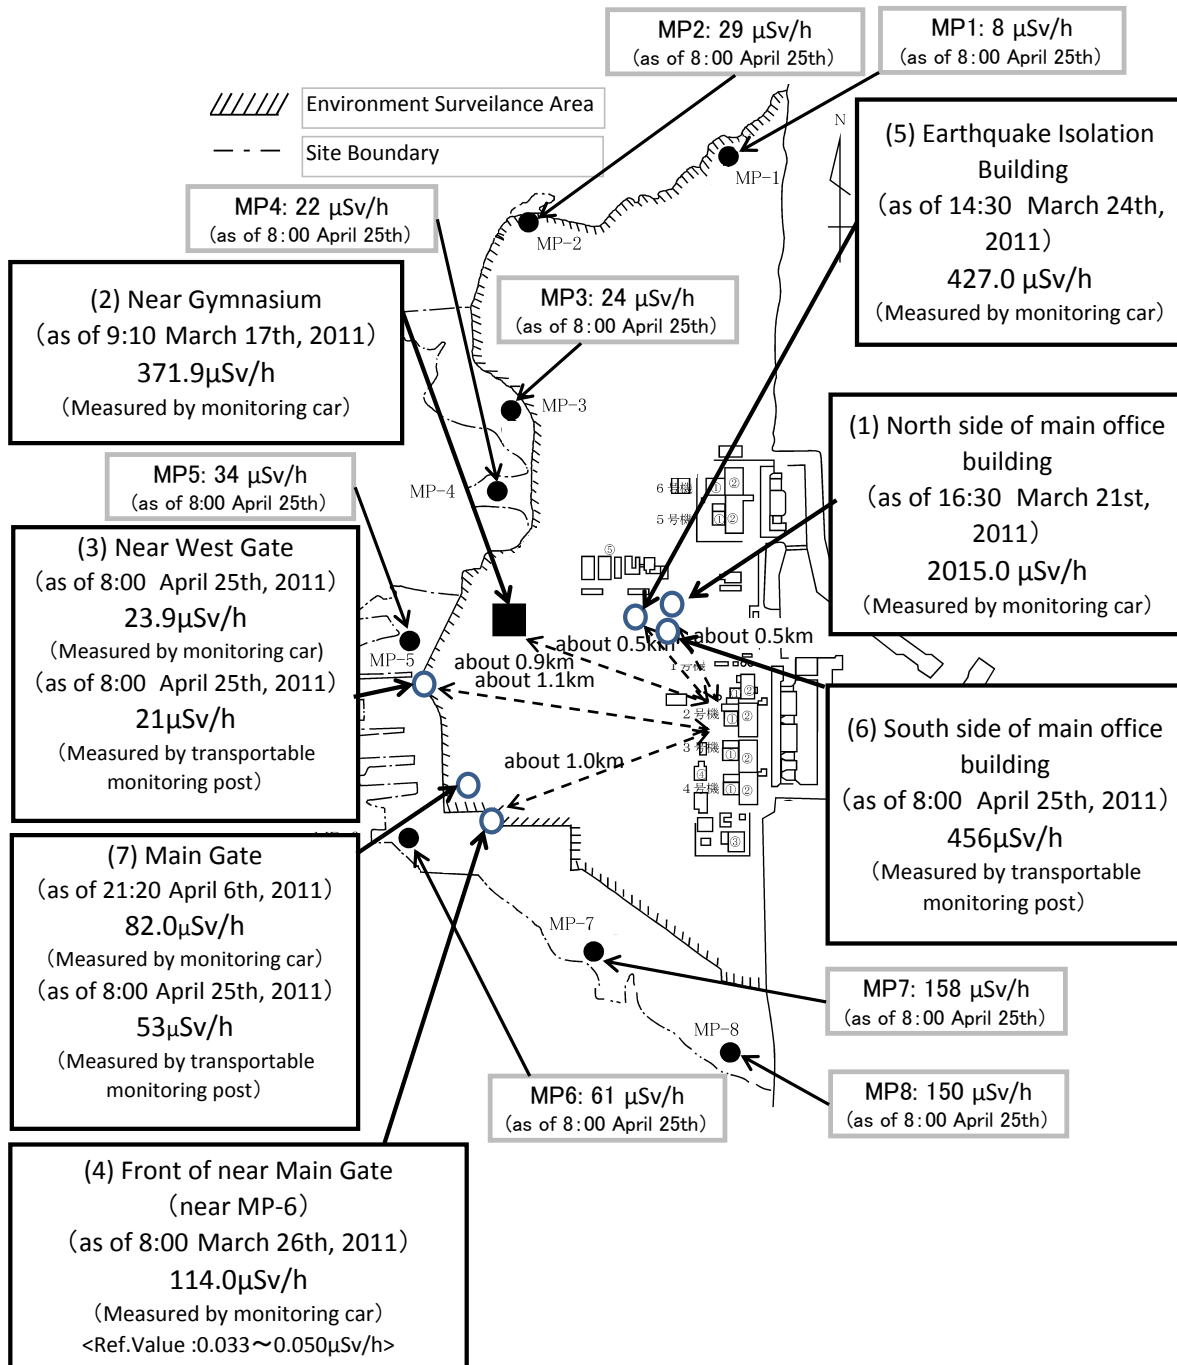

Fukushima Dai-ni NPS

as of 10:00, April 25th, 2011

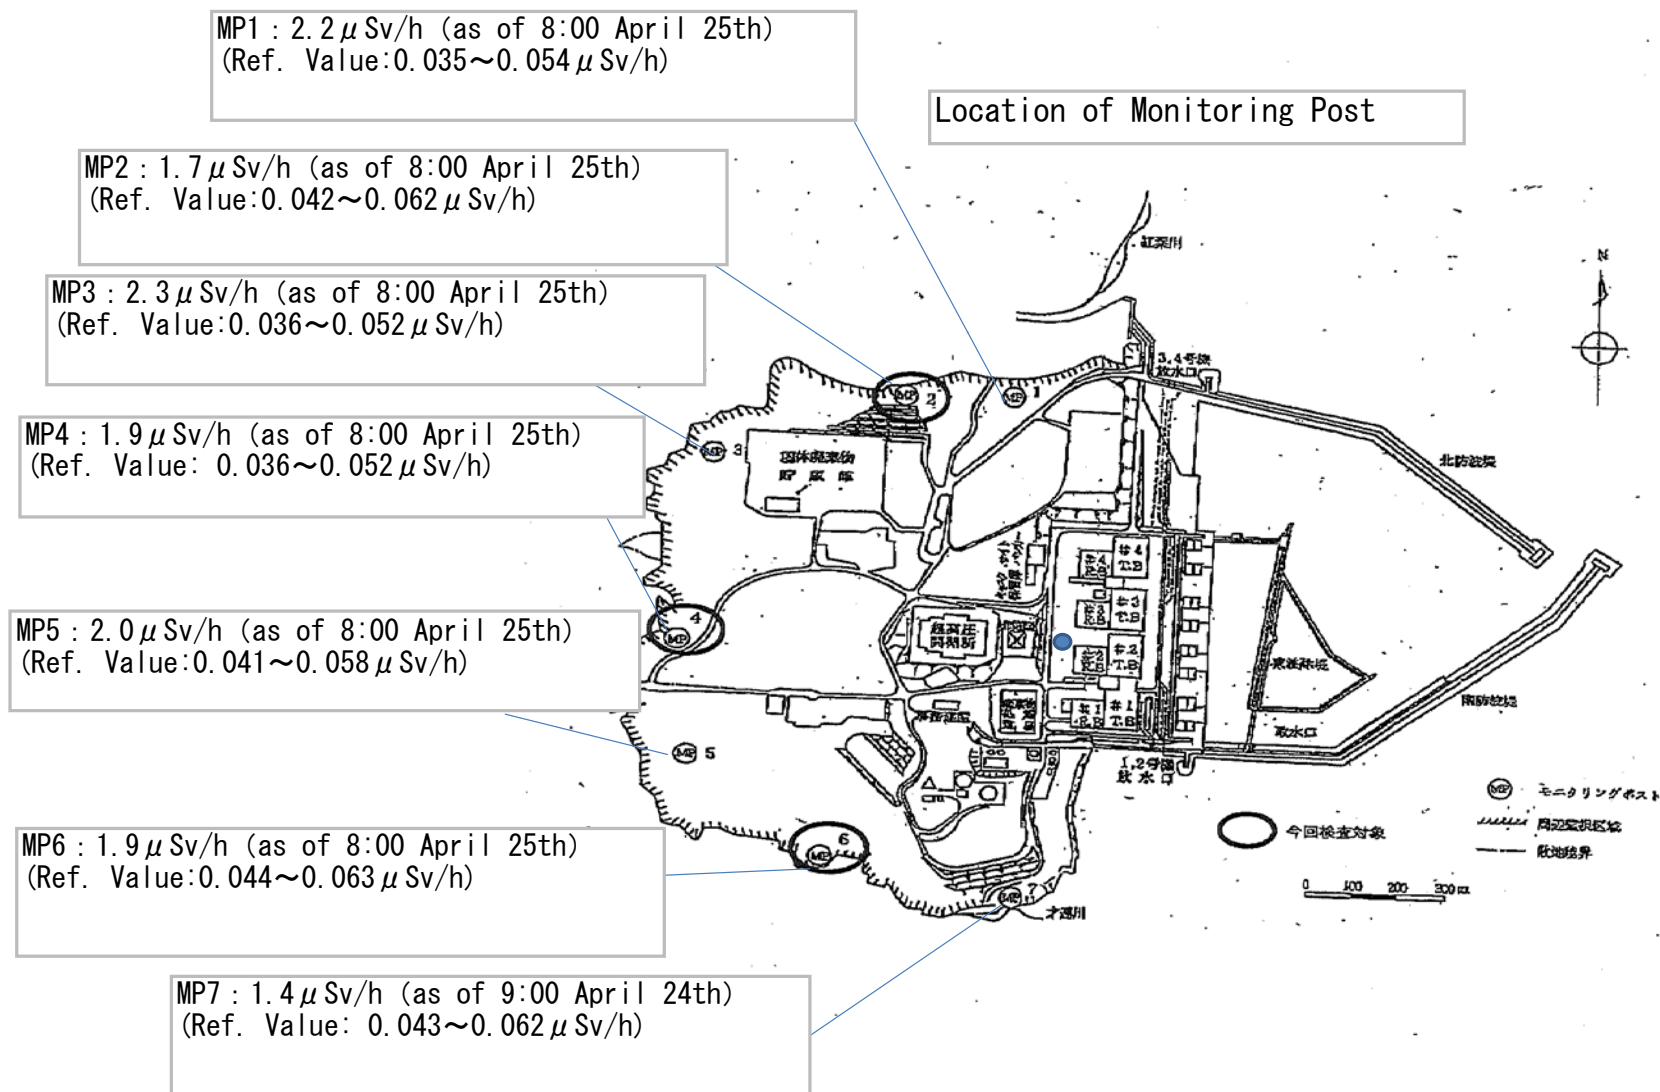

Results of environmental monitoring at each NPSs etc. (as of 9:00PM, April 24th)

unit: μ Sv/h

Unit: g/cm³

Range of normal average value	Company	NPS	April 24, 2011											
			0:00	1:00	2:00	3:00	4:00	5:00	6:00	7:00	8:00	9:00	10:00	11:00
0.023~0.027	Hokkaido Electric Power Co.	Tomari NPS	0.038	0.038	0.039	0.043	0.044	0.038	0.034	0.032	0.031	0.031	0.032	0.032
0.024~0.060	Tohoku Electric Power Co.	Onagawa NPS	0.27	0.26	0.26	0.26	0.26	0.26	0.26	0.26	0.26	0.26	0.26	0.26
0.012~0.060		Higashidori NPS	0.023	0.023	0.028	0.032	0.036	0.027	0.02	0.018	0.018	0.018	0.018	0.018
0.033~0.050	Tokyo Electric Power Co.	Fukushima Dai-ichi [※]	(publicized in another place.)											
0.036~0.052		Fukushima Dai-ni												
0.011~0.159	Japan Atomic Power Co.	Kashiwazaki kariwa NPS	0.084	0.071	0.073	0.070	0.067	0.065	0.066	0.066	0.065	0.066	0.067	0.065
0.036~0.053		Tokai Dai-ni NPS	0.324	0.320	0.320	0.325	0.320	0.322	0.321	0.323	0.322	0.322	0.324	0.324
0.039~0.110		Tsuruga NPS	0.073	0.072	0.071	0.072	0.072	0.073	0.072	0.073	0.073	0.072	0.073	0.074
0.064~0.108	Chubu Electric Power Co.	Hamaoka NPS	0.043	0.042	0.042	0.042	0.042	0.042	0.042	0.042	0.042	0.042	0.042	0.042
0.0207~0.132	Hokuriku Electric Power Co.	Shika NPS	0.033	0.033	0.033	0.034	0.033	0.034	0.034	0.033	0.034	0.033	0.034	0.034
0.028~0.130	Chugoku Electric Power Co.	Shimane NPS	0.031	0.030	0.020	0.031	0.031	0.031	0.029	0.029	0.029	0.030	0.030	0.030
0.070~0.077		Mihama NPS	0.071	0.072	0.071	0.072	0.073	0.071	0.071	0.072	0.072	0.071	0.072	0.072
0.045~0.047		Takahama NPS	0.043	0.042	0.042	0.042	0.042	0.043	0.043	0.043	0.044	0.043	0.043	0.043
0.036~0.040		Ooi NPS	0.035	0.035	0.035	0.035	0.036	0.035	0.035	0.035	0.035	0.035	0.035	0.035
0.011~0.080	Shikoku Electric Power Co.	Ikata NPS	0.013	0.014	0.014	0.013	0.014	0.014	0.014	0.014	0.014	0.013	0.014	0.014
0.023~0.087	Kyushu Electric Power Co.	Genkai NPS	0.027	0.026	0.026	0.027	0.026	0.026	0.025	0.026	0.026	0.026	0.027	0.028
0.034~0.120		Sendai NPS	0.036	0.037	0.036	0.037	0.040	0.040	0.040	0.040	0.037	0.036	0.038	0.035
0.009~0.069	Japan Nuclear Fuel Limited	Japan Nuclear Fuel Reprocessing Plant	0.021	0.022	0.023	0.026	0.028	0.021	0.017	0.017	0.017	0.016	0.017	0.017
0.009~0.071		Japan Nuclear Fuel Plant Disposal	0.028	0.028	0.030	0.032	0.034	0.028	0.024	0.022	0.023	0.022	0.023	0.022

※ Chubu Electric Power Co. reported that from 12:00, April 1st, the data did not include the contribution of cosmic rays.

Range of normal average value	Company	NPS	April 24, 2011											
			12:00	13:00	14:00	15:00	16:00	17:00	18:00	19:00	20:00	21:00	22:00	23:00
0.023~0.027	Hokkaido Electric Power Co.	Tomari NPS	0.032	0.032	0.032	0.033	0.032	0.032	0.035	0.037	0.043	0.050		
0.024~0.060	Tohoku Electric Power Co.	Onagawa NPS	0.26	0.26	0.26	0.26	0.26	0.26	0.26	0.26	0.26	0.26		
0.012~0.060		Higashidori NPS	0.018	0.018	0.018	0.022	0.019	0.018	0.018	0.018	0.018	0.018		
0.033~0.050	Tokyo Electric Power Co.	Fukushima Dai-ichi [※]	(publicized in another place.)											
0.036~0.052		Fukushima Dai-ni												
0.011~0.159	Japan Atomic Power Co.	Kashiwazaki kariwa NPS	0.066	0.066	0.067	0.066	0.066	0.067	0.065	0.065	0.067	0.065		
0.036~0.053		Tokai Dai-ni NPS	0.327	0.328	0.328	0.324	0.326	0.334	0.339	0.336	0.324	0.319		
0.039~0.110		Tsuruga NPS	0.072	0.073	0.075	0.074	0.072	0.071	0.072	0.073	0.071	0.072		
0.064~0.108	Chubu Electric Power Co.	Hamaoka NPS	0.042	0.042	0.042	0.042	0.043	0.042	0.042	0.043	0.042	0.042		
0.0207~0.132	Hokuriku Electric Power Co.	Shika NPS	0.033	0.033	0.033	0.033	0.033	0.033	0.032	0.032	0.033	0.033		
0.028~0.130	Chugoku Electric Power Co.	Shimane NPS	0.029	0.029	0.028	0.029	0.030	0.028	0.030	0.030	0.030	0.030		
0.070~0.077		Mihama NPS	0.072	0.073	0.079	0.076	0.073	0.072	0.073	0.071	0.073	0.073		
0.045~0.047	Kansai Electric Power Co.	Takahama NPS	0.043	0.051	0.051	0.048	0.044	0.044	0.045	0.043	0.043	0.043		
0.036~0.040		Ooi NPS	0.035	0.049	0.051	0.047	0.039	0.036	0.038	0.036	0.040	0.038		
0.011~0.080	Shikoku Electeic Power Co.	Ikata NPS	0.013	0.014	0.013	0.013	0.014	0.014	0.013	0.013	0.014	0.014		
0.023~0.087	Kyushu Electric Power Co.	Genkai NPS	0.026	0.027	0.026	0.028	0.026	0.027	0.026	0.026	0.027	0.026		
0.034~0.120		Sendai NPS	0.038	0.037	0.041	0.035	0.036	0.037	0.040	0.039	0.039	0.037		
0.009~0.069	Japan Nuclear Fuel Limited	Japan Nuclear Fuel Reprocessing Plant	0.017	0.017	0.017	0.017	0.017	0.016	0.016	0.017	0.016	0.017		
0.009~0.071		Japan Nuclear Fuel Plant Disposal	0.017	0.017	0.017	0.017	0.017	0.016	0.016	0.017	0.016	0.017		

※ Chubu Electric Power Co. reported that from 12:00, April 1st, the data did not include the contribution of cosmic rays.